


**NOTE:**  
 1. ALL LOCATIONS APPROXIMATE  
 2. PROPOSED TANK CONSISTS OF NOMINAL 500,000 GALLON WELDED STEEL ABOVE GROUND KEROSENE STORAGE TANK (API-650), APPROXIMATELY 50 FOOT DIAMETER BY 45 FEET HIGH. TANK TO BE SURROUNDED BY WELDED STEEL OUTER CONTAINMENT TANK STRUCTURE, APPROXIMATELY 60 FOOT DIAMETER, FOR SPILL PREVENTION.

**LEGEND**

	EASEMENT BOUNDARY LINE IN FAVOR OF CL&P
	OVERHEAD ELECTRIC WIRE
	OVERHEAD COMMUNICATIONS LINE
	FUEL OIL PIPE
	PROPOSED FUEL OIL PIPE
	UTILITY POLE
	POLE GUY

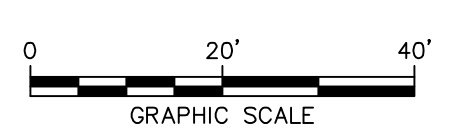

NO.	REVISIONS	DATE	APPROVAL
<b>CONNECTICUT RESOURCES RECOVERY AUTHORITY</b> MAXIM AND RESERVE ROAD HARTFORD, CONNECTICUT			
<b>TANK NO.6 REPLACEMENT PROJECT</b> <b>SEDIMENTATION &amp; EROSION CONTROL</b> <b>PLAN</b>		 21 Griffin Road North Windsor, CT 06095 (860) 298-9692	
DESIGN:	SWL	07/16/10	
DRAWN:	REA	07/16/10	
CHECKED:	CNS	07/16/10	
SCALE:	1"=20'		
PROJECT:	153306-000390-000006		
DRAWING			

J:\CAD\153306\000390\Design Documents\PLATE-1.dwg Layout-C-4 July 16, 2010-11:04AM Rolando